

Lovibond® Water Testing

Tintometer® Group



Industrial Legionella Field Test™ Kit

This kit is designed to test for Legionella in risk areas identified by CDC* such as:

- Pipe fittings in domestic and industrial hot and cold water systems.
- Cooling towers.
- Showers.
- Water tanks.




*The Centers for Disease Control and Prevention (CDC) is a federal agency that conducts and supports health promotion, prevention and preparedness activities in the United States, with the aim of improving overall public health.

Industrial Legionella Field Test™ product code 56B006101

The test kit contains all the items required to perform 5 tests and includes a fitting for connection to water systems.

- The test detects Legionella pneumophila serogroup 1 (LpSG1).
- With filtration step, the sensitivity of the water test is 100 CFU/L.
- The test detects Viable-But-Non-Culturable Bacteria and Legionella SG1 in all stages of its life-cycle.
- Hassle free sample collection. Simply connect sample point to the water system and use system pressure to drive the filtration process.
- The kit includes single-use filtration modules.
- The kit includes pre-filled syringes containing recovery buffer. No need to measure or dilute solutions.
- The test is simple to use and helps to minimise delays and downtime.
- The test provides straightforward results, on-site, within 25–35 minutes.
- Regular use increases confidence in Legionella controls.
- The smartphone App reader provides independent records of results (download the App for free from the App store or Play Store).

The Lovibond® Legionella Field Test™ uses Lateral Flow Immunochromatographic Assay (LFICA) technology to detect the presence of cell surface antigens from Legionella bacteria. It uses Legionella antibodies, tagged with red nanoparticles, which bind to any bacteria found in the sample and make them visible on a line on the device. The test works just like a pregnancy test - one line indicates a negative result and two lines indicate a positive result.

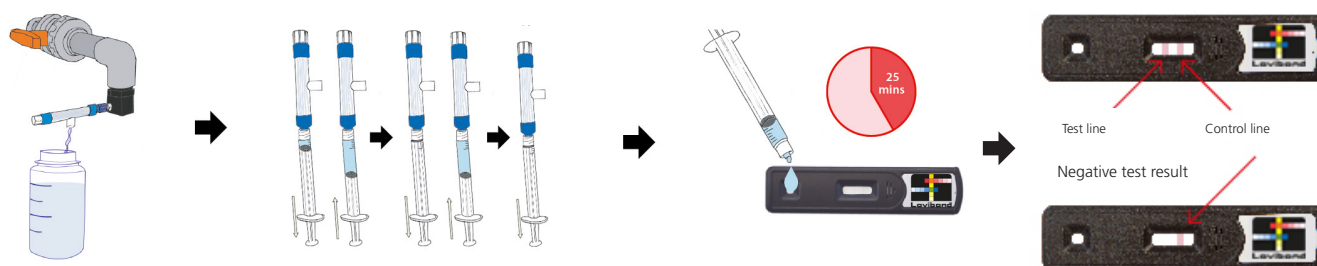

Lovibond® Water Testing

Tintometer® Group



Industrial Legionella Field Test™ Kit

Bacteria detected	Legionella pneumophila serogroup 1													
Detection method	Lateral flow immunochromatographic assay													
Limit of detection	100 CFU/L (0.1 CFU/mL)													
Specificity	Tested against a wide range of waterborne bacteria, including Acinetobacter calcoaceticus, Aeromonas hydrophila subsp. hydrophila, Bacillus subtilis, Burkholderia cepacia, Citrobacter freundii, Citrobacter koseri, Escherichia coli, Enterobacter cloacae, Klebsiella oxytoca, Pseudomonas aeruginosa, Pseudomonas fluorescens, Pseudomonas putida, Pseudomonas stutzeri, Ralstonia pickettii, Raoultella terrigena, Streptococcus pyogenes, Yersinia ruckeri. <table><tr><td>Organism</td><td>≥cfu/mL</td></tr><tr><td>L.p Sg-2,3,8,11,13,14</td><td>1.00E+08</td></tr><tr><td>L.p. Sg-4,5,6,7,9,10,15</td><td>1.00E+07</td></tr><tr><td>L.p. Sg-12</td><td>8.00E+06</td></tr><tr><td>S.aureus</td><td>2.00E+08</td></tr></table> The Lovibond® Legionella pneumophila SG1 test has been shown to produce weak positive results with other legionella pneumophila serogroups at the cfu/mL stated in the above table.		Organism	≥cfu/mL	L.p Sg-2,3,8,11,13,14	1.00E+08	L.p. Sg-4,5,6,7,9,10,15	1.00E+07	L.p. Sg-12	8.00E+06	S.aureus	2.00E+08		
Organism	≥cfu/mL													
L.p Sg-2,3,8,11,13,14	1.00E+08													
L.p. Sg-4,5,6,7,9,10,15	1.00E+07													
L.p. Sg-12	8.00E+06													
S.aureus	2.00E+08													
Test Volume	100 µL													
Suggested sample volume	250 mL													
Sample parameters	<table><tr><td>pH range</td><td>5–10</td></tr><tr><td>Sample temperature range</td><td>15–45 °C (59–113 °F)</td></tr><tr><td>Environmental operating range 1</td><td>5–40 °C (59–104 °F)</td></tr><tr><td>Free chlorine concentration</td><td><5ppm</td></tr><tr><td>Total Alkalinity</td><td><1000 ppm</td></tr><tr><td>Total Hardness</td><td><1000 ppm</td></tr></table> Sample should filter in less than 10 minutes.		pH range	5–10	Sample temperature range	15–45 °C (59–113 °F)	Environmental operating range 1	5–40 °C (59–104 °F)	Free chlorine concentration	<5ppm	Total Alkalinity	<1000 ppm	Total Hardness	<1000 ppm
pH range	5–10													
Sample temperature range	15–45 °C (59–113 °F)													
Environmental operating range 1	5–40 °C (59–104 °F)													
Free chlorine concentration	<5ppm													
Total Alkalinity	<1000 ppm													
Total Hardness	<1000 ppm													
Biocides	The product has been tested with a range of common biocides and biodispersants used in Legionella control, at their normal maximum operating concentration. Active ingredients tested include: glutaraldehyde, didecyl-dimethyl-ammonium chloride, isothazoles, dibromonitrilopropionamide, ionic and non-ionic surfactants. The test gives a false positive if used with systems treated with polymeric biguanide or THPS. It should not be used to test such systems.													
Operator time	5–10 minutes													
Test time	25 minutes													
Sample point fitting	Supplied with both ½" and ¾" female threaded fittings. Additional sample points are available (part no. 100171).													
Shelf life	18 months from date of manufacture, when stored at room temperature (<30°C) in original packaging. All test strips are hermetically foil-wrapped and with a printed expiry date.													

Limit of detection

Laboratory analysis has demonstrated that tests are positive for clean water samples containing 100 CFU/Litre *Legionella pneumophila* serogroup 1. The limit of detection (LOD) of the test is equivalent to 100 CFU/L when a 250 ml sample is filtered. If smaller volumes are processed the detection limit will be altered accordingly.

Suspended solid content in water samples affects filtration and test performance, including analytical sensitivity. Actual results will vary. Water samples with high levels of suspended solids may block filtration entirely. *L. pneumophila* serogroup 1 bacteria recovery from water samples can range from <10 to 100%, depending on water sample composition. This is similar to filtration concentration techniques used in other microbiological analysis methods.

Test operating limits

The test has been evaluated for operation on samples between 10–45°C (50–113°F). The test has been validated for samples that filter in less than 10 minutes. Samples requiring greater than 10 minutes to filter may give erroneous results. Samples requiring long periods to filter may be indicative of poor system maintenance.

A wide range of non-oxidizing biocides and biocidal dispersants have been checked for cross reaction and interference with the test.

The test should not be used on systems treated with biguanide or tetrakis hydroxymethyl phosphonium sulfate (THPS) based biocides.

Specificity

The test has been shown to be non-reactive with the following bacteria (at 1x10⁸ organisms per sample):

- | | |
|--|-------------------------------|
| • <i>Acinetobacter calcoaceticus</i> | • <i>Citrobacter freundii</i> |
| • <i>Aeromonas hydrophila</i> subsp. <i>Hydrophila</i> | • <i>Citrobacter koseri</i> |
| • <i>Bacillus subtilis</i> | • <i>Enterobacter cloacae</i> |
| • <i>Burkholderia cepacia</i> | • <i>Escherichia coli</i> |
| | • <i>Klebsiella oxytoca</i> |
| | • <i>Pseudomonas</i> |

- | | |
|----------------------------------|---------------------------------|
| <i>aeruginosa</i> | • <i>Ralstonia pickettii</i> |
| • <i>Pseudomonas fluorescens</i> | • <i>Raoultella terrigena</i> |
| • <i>Pseudomonas putida</i> | • <i>Streptococcus pyogenes</i> |
| • <i>Pseudomonas stutzeri</i> | • <i>Yersinia ruckeri</i> |

Organism	≥cfu/mL
L.p Sg-2,3,8,11,13,14	1.00E+08
L.p. Sg-4,5,6,7,9,10,15	1.00E+07
L.p. Sg-12	8.00E+06
S.aureus	2.00E+08

The Lovibond® Legionella Test™ has been shown to produce weak positive results with other legionella pneumophila serogroups at the cfu/mL stated in the above table.

Storage

The test is intended for storage at room temperature 18–22°C (64.4–71.6°F). Do not freeze. When stored correctly, the test will continue to operate within design specification, until the specified expiration date.

Do not use the test or the recovery buffer syringe after the date specified on the packaging of the test. Do not use any test where the foil packaging is perforated.

Disposal

The test, filter, syringe and caps cannot be reused or recycled. The packaging materials and this instruction leaflet can be recycled.

Lovibond® Water Testing

Tintometer® Group



Industrial Legionella Test™ Kit

Instructions

This kit is designed to test for Legionella in risk areas identified by CDC* such as:

- Pipe fittings in domestic and industrial hot and cold water systems.
- Cooling towers.
- Showers.
- Water tanks.

*Centers for Disease Control and Prevention

Industrial Legionella Field Test product code: 56B006101




Overview

This test is used to detect the presence of *Legionella pneumophila* serogroup 1 bacteria in water samples from a wide range of sources. The test operates via a Lateral Flow Immunochromatographic Assay (LFICA). Each kit contains the following:

- 5 x individual foil wrapped tests.
- 5 x hollow fibre filters.
- 5 x syringes containing recovery buffer.
- 1 x filtrate collection bottle.
- 1 x pipework adaptor with 1/2" and 3/4" female threaded connectors. Note that this can also connect to a shower head thread.


The product is intended for use as part of an overall water treatment, management and risk reduction approach and, as all testing methods including lab culture testing, should NOT be used as the sole method for assessing risks associated with Legionella bacteria.

This test is intended for the analysis of water samples only. It is NOT intended for the diagnostic testing, in a clinical or medical situation, of Legionnaires' Disease in humans.

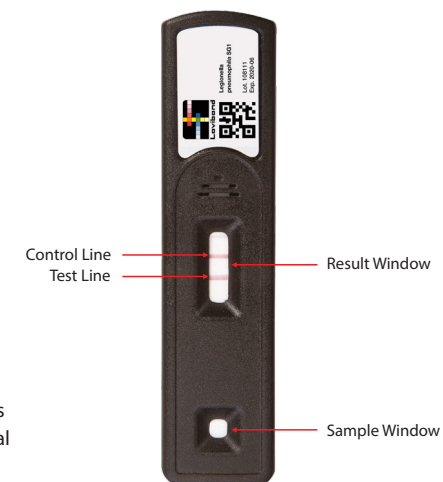

www.lovibond.com

Test procedure

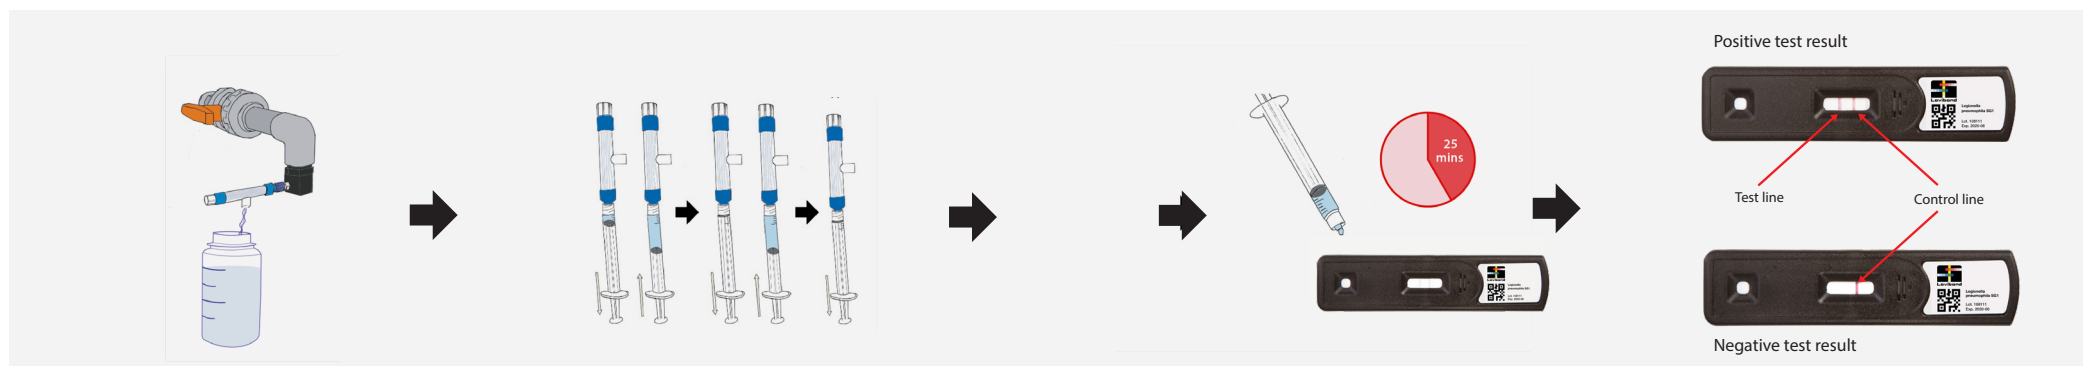

For optimum results the test should be performed at room temperature. The foil wrapping should NOT be opened until immediately prior to running the test. If the foil is opened and the test is NOT performed within 60 minutes discard the test.

Step 1. Fit the pipework adaptor

Attach a pipework adaptor to an appropriate connector from which to obtain a representative sample. Lovibond recommends that a separate pipework adaptor be fitted and retained at each sample point to avoid cross contamination. The sample line pressure should not exceed 6 bar (87 psi).

Step 2. Take a sample

Remove the filter from the packaging and tighten the cap at the end. Attach the filter to the pipework adaptor; push the open end of the filter into the plastic luer fitting and twist the locking ring to secure. Hold the filtrate collection bottle under the clear outlet port of the filter. Open the system valve to allow the filtration to start, filter at least 250 ml of water into the bottle and close off the valve.

If the sample takes longer than 10 minutes to filter then stop the filtration process and measure the amount of liquid in the collection bottle before proceeding to step 3. The detection limit will be alerted.



Avoid generating aerosols when collecting or handling samples.

Step 3. Recover the bacteria

Disconnect the filter from the pipework adaptor by twisting the lock ring and pulling the filter from the fitting. Hold the filter vertically with the cap at the top and the open end pointing towards the floor. Remove the cap and screw it onto the open (opposite) end of the filter. Now take the small red capped syringe of recovery buffer, remove the red cap and attach the syringe to the now open end of the hollow fibre filter with a twist and turn movement.

- Pull the syringe plunger back to the **0.5 ml** mark, then push the syringe all the way to the **0 ml** mark.
- Repeat step (a) a further 2 times (total of 3).
- Draw the syringe back to the **0.5 ml** mark to collect the sample then slowly push the syringe plunger in to the **0.1 ml** mark. Avoid creating air bubbles in the collected 0.1 ml sample. If necessary, push and pull the syringe plunger again to remove any air bubbles. Disconnect the syringe from the hollow fibre filter.
- The syringe now contains **0.1 ml** of any recovered bacteria ready for testing.

Incorrect use of the syringe can cause flooding of the test (too much sample added) or failure to run (insufficient sample added). Please ensure that correct amount (0.1 ml) of sample has been collected.

Step 4. Add sample to test strip

Remove the test strip from its foil wrapping, and place it on a flat surface. Before use, the test should have

two pale blue lines across the result window. Place the recovery buffer syringe over the small sample window at one end of the test strip. Depress the plunger to dispense the 0.1 ml of recovery buffer, containing any bacteria, onto the test strip.

RECORD THE TIME. Allow the test to develop at room temperature for 25 minutes. Leave the test strip sitting on a flat surface during development.

Step 5. Interpreting the results

Leave the test strip sitting on a flat surface during incubation. After 25 minutes, examine the test strip in good lighting. If the test is not read within 30 minutes of adding the water sample, it should be discarded and a new test should be run.

The test should show one of the following results in the large result window on the test strip:

- Two RED lines across the result window. The red line closest to the sample window may be very faint (pale pink). Any distinct line, no matter how faint should be considered to be a POSITIVE result.

OR

- One RED line across the result window at the end furthest from the sample window. This is a NEGATIVE result.

Positive Results

If a positive result is observed, consult your risk management plan or seek advice from a water management specialist immediately.

Positive test result



Negative test result



Negative Results

A negative result indicates that Legionella pneumophila serogroup 1 was not detected and the concentration was below the detection limit of the test.

Invalid Tests

In the unlikely event that a test does not show any red lines, or if it only shows a line at the end closest to the sample window, or if the line furthest from the sample window is very faint, then the test result is invalid. Repeat the test.

Performance Factors

A positive test result indicates that Legionella pneumophila serogroup 1 was present in the sample above the detection limit. The test does not differentiate between viable and non-viable organisms. The test will detect dangerous viable but non-culturable bacteria, which cannot be detected by traditional laboratory techniques. A positive result does not necessarily mean that viable bacteria are present.

A negative result does not mean that the system is completely free from risks associated with Legionella bacteria.

The test detects Legionella pneumophila serogroup 1. The test does not detect the presence of other Legionella species or serogroups.